keeping you safe

AIRIUS CEILING KIT MOUNTING GUIDELINES - PUREAIR PHI SERIES (SUSPENDED) - Model 10, 15, 25, (Long & Short Nozzle) - Option 1

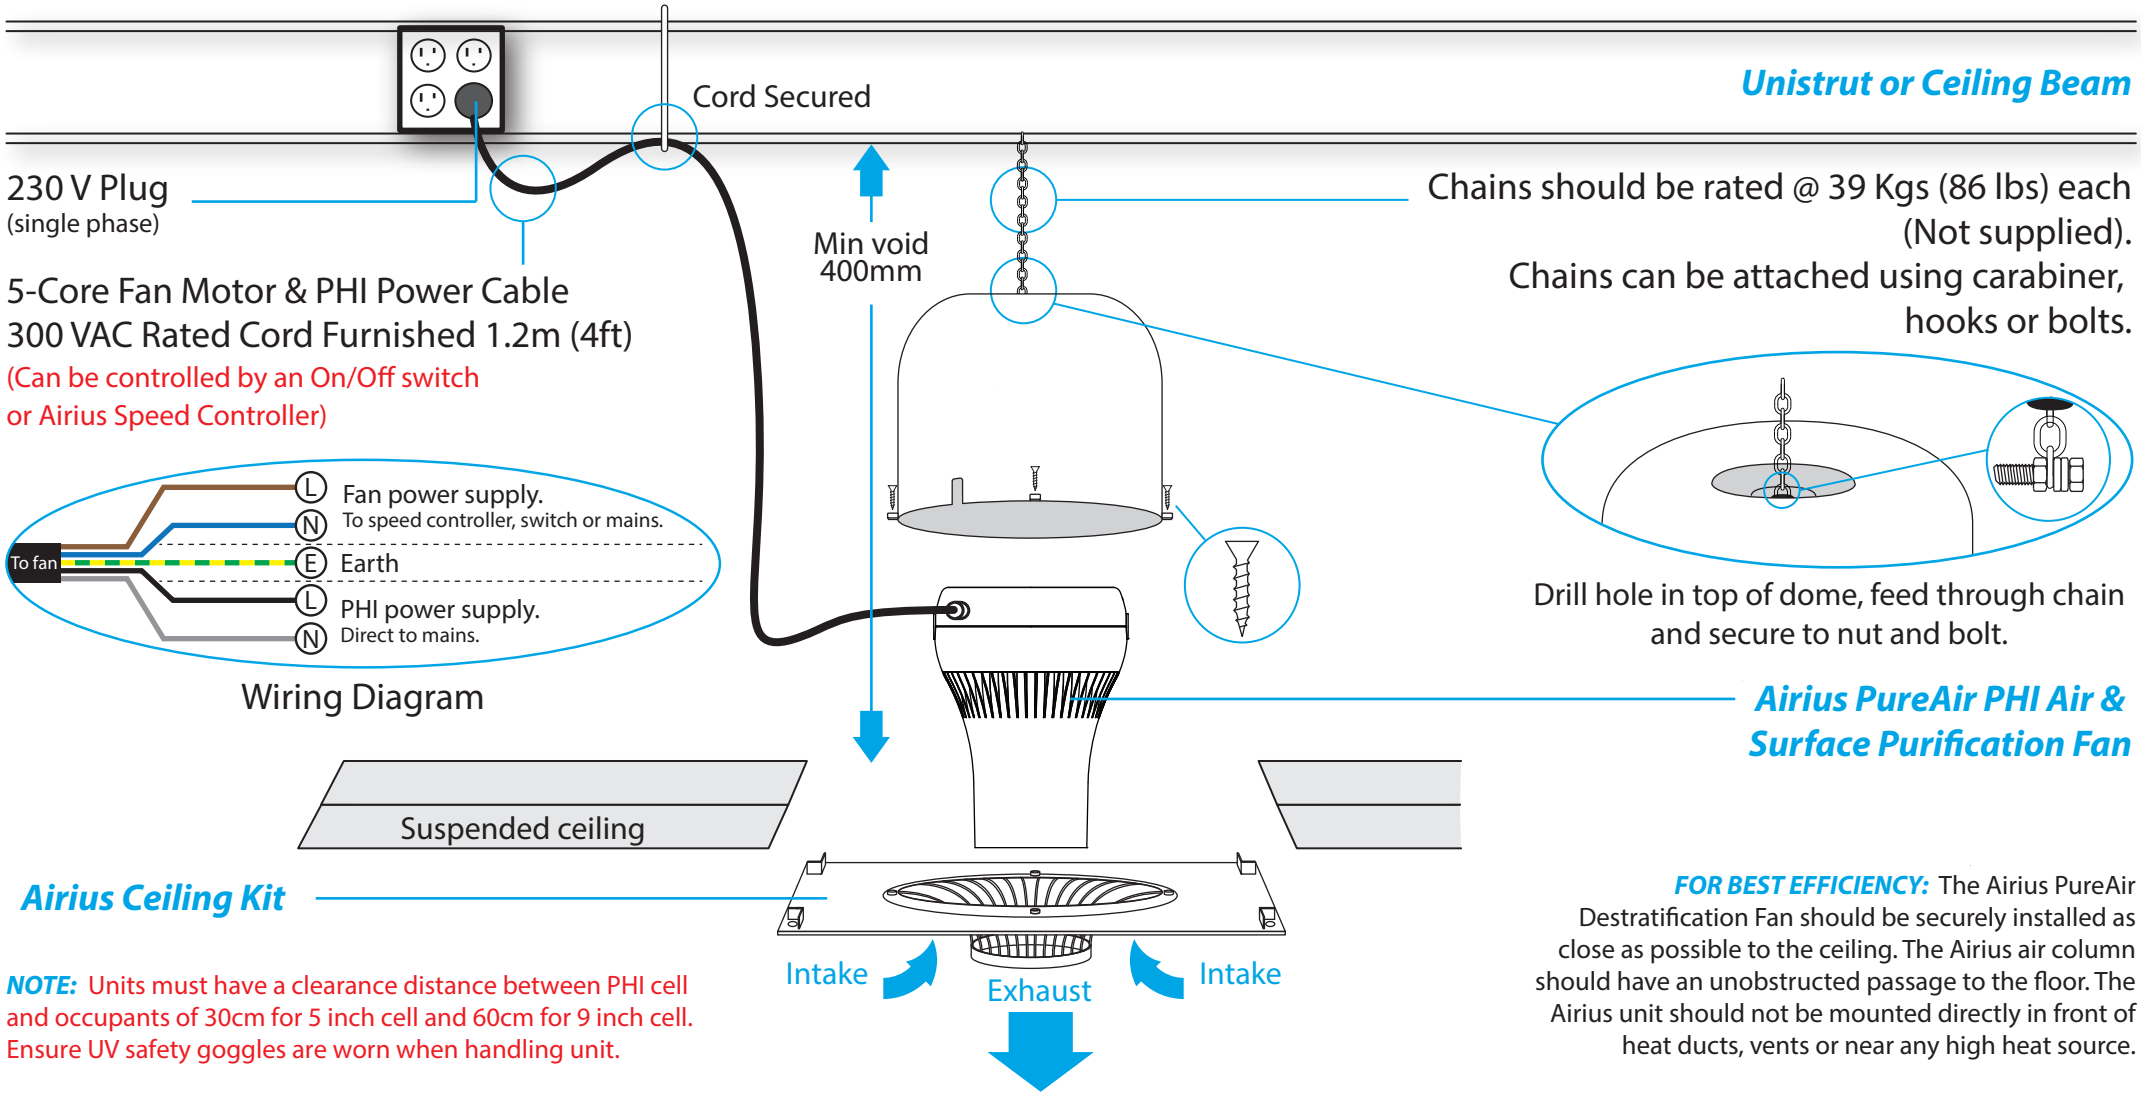

NOTE: Units must have a clearance distance between PHI cell and occupants of 30cm for 5 inch cell and 60cm for 9 inch cell. Ensure UV safety goggles are worn when handling unit.

FOR BEST EFFICIENCY: The Airius PureAir Destratification Fan should be securely installed as close as possible to the ceiling. The Airius air column should have an unobstructed passage to the floor. The Airius unit should not be mounted directly in front of heat ducts, vents or near any high heat source.

Holwell Farm, Cranborne
Dorset BH21 5QP

E: airflow@airius.co.uk
W: www.airius.co.uk

Office: +44 (0)1202 554200
Fax: +44 (0)1202 554396

AIRIUS®, AIR PEAR®, and THE THERMAL EQUALIZER® are trademarks of Airius, LLC, registered in the U.S. and in some countries abroad. Other trademarks pending in the U.S. and abroad.

keeping you safe

AIRIUS CEILING KIT MOUNTING GUIDELINES - PUREAIR PHI SERIES (SUSPENDED) - Model 10, 15, 25, (Long & Short Nozzle) - Option 2

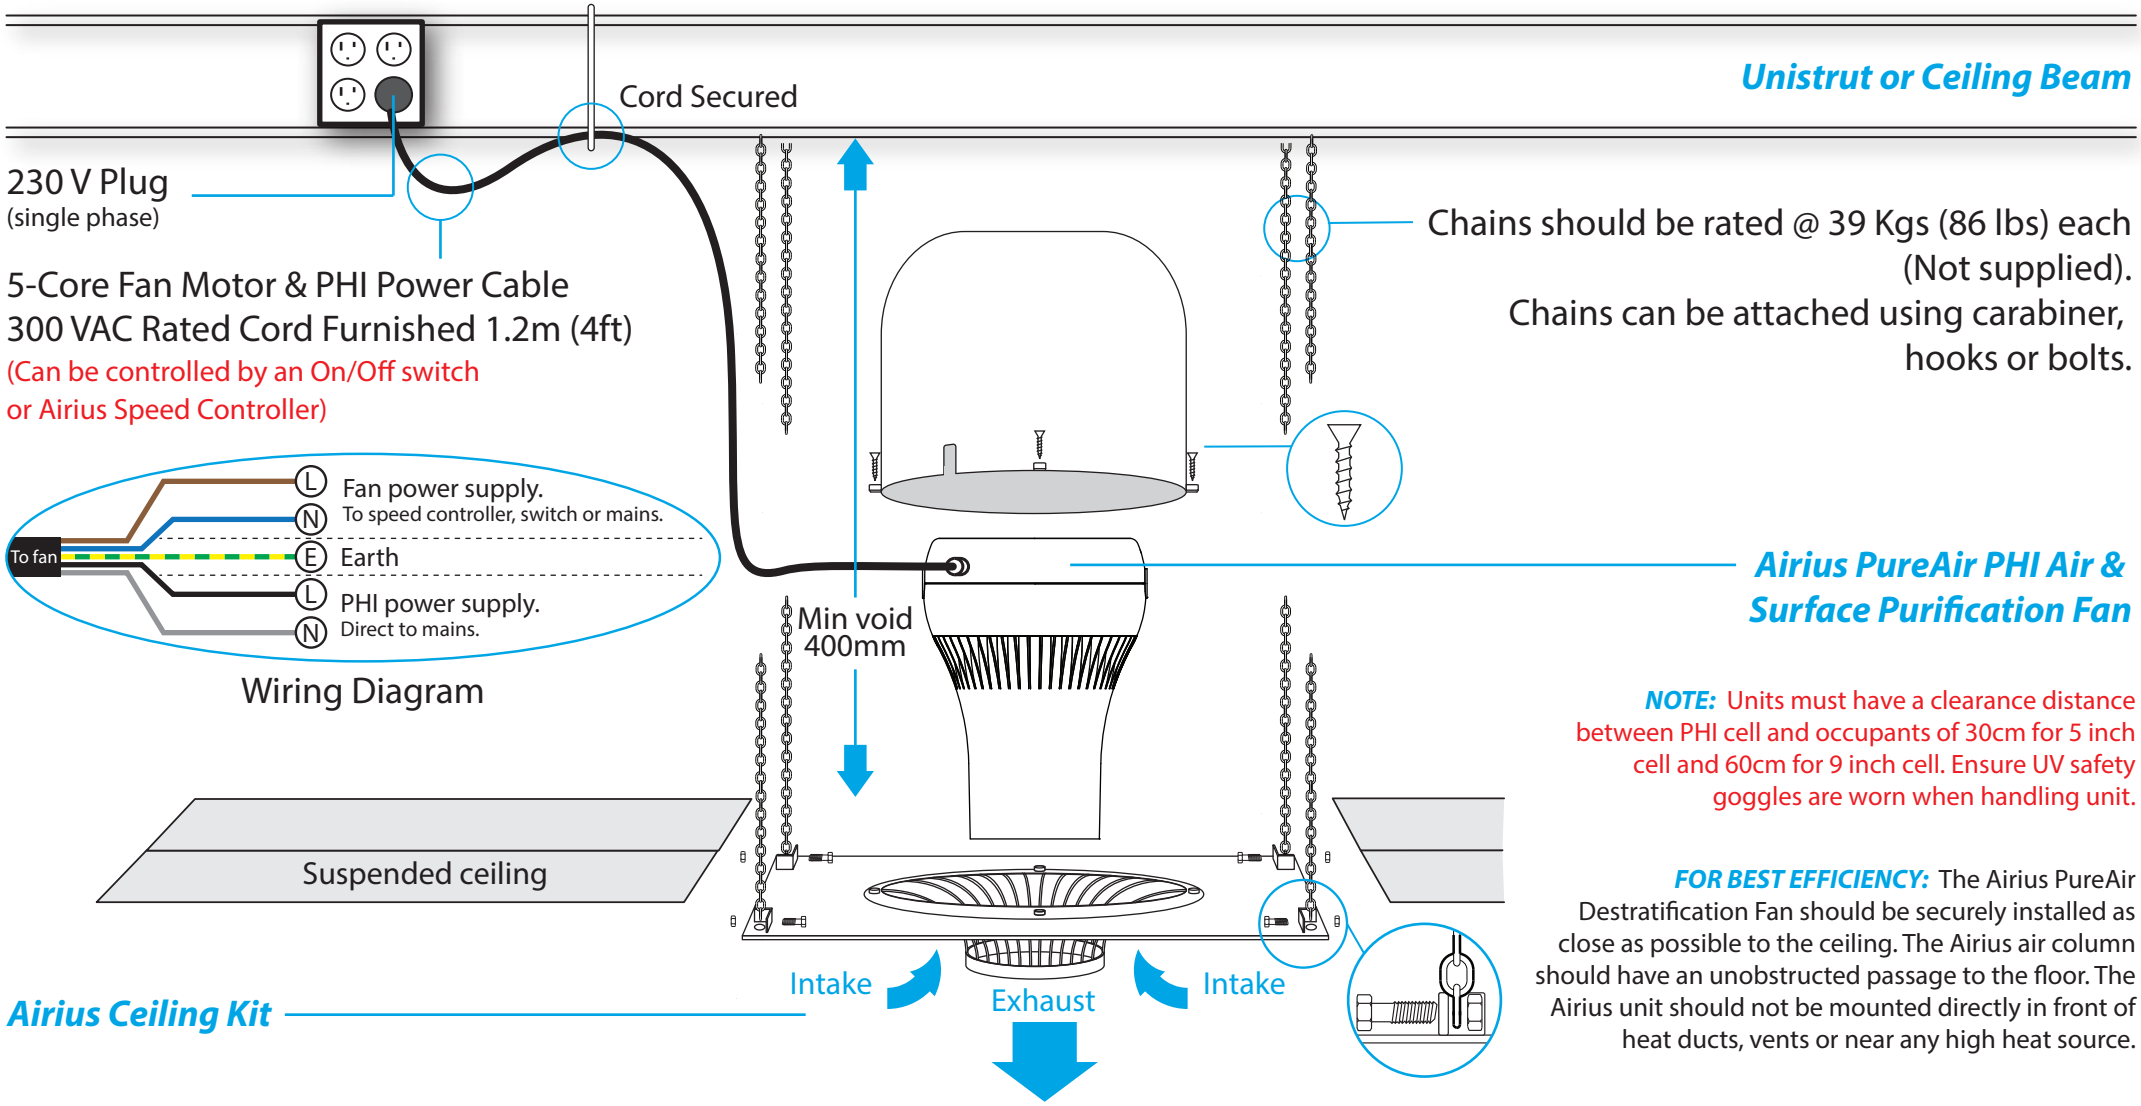

NOTE: Units must have a clearance distance between PHI cell and occupants of 30cm for 5 inch cell and 60cm for 9 inch cell. Ensure UV safety goggles are worn when handling unit.

FOR BEST EFFICIENCY: The Airius PureAir Destratification Fan should be securely installed as close as possible to the ceiling. The Airius air column should have an unobstructed passage to the floor. The Airius unit should not be mounted directly in front of heat ducts, vents or near any high heat source.

Holwell Farm, Cranborne
Dorset BH21 5QP

E: airflow@airius.co.uk
W: www.airius.co.uk

Office: +44 (0)1202 554200
Fax: +44 (0)1202 554396

AIRIUS®, AIR PEAR®, and THE THERMAL EQUALIZER® are trademarks of Airius, LLC, registered in the U.S. and in some countries abroad. Other trademarks pending in the U.S. and abroad.